




DİZEL MOTOR JENERATÖR
GRUBU MONTAJ, ÇALIŞTIRMA,
KULLANMA ve BAKIM EL KİTABI

DIESEL GENERATING SETS
INSTALLATION RECOMMENDATIONS
AND OPERATIONS MANUAL

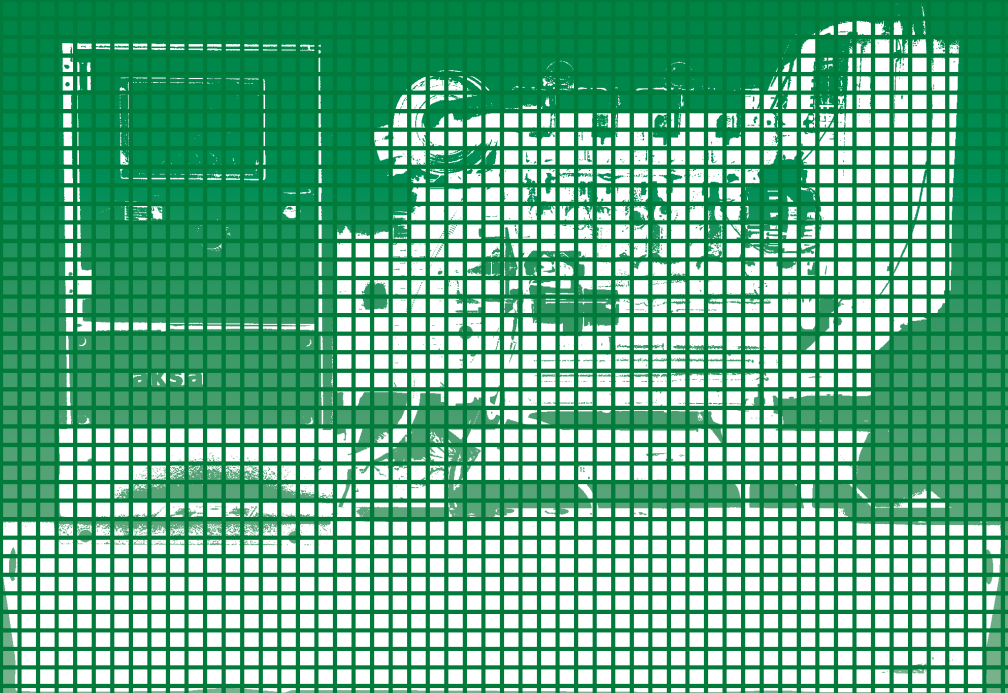

8 - 30 kVA

Dear Aksa Generating Set Users;

First of all, we would like to thank you for your choice of Aksa Generating Set.

It is solid, safe and reliable machine, built according to the latest technology.

This maintenance and user manual is designed and developed to make you familiar with the generating system.

Please read the following instructions carefully before starting to use your machine.

This manual gives general information about mounting, of the generating set.

Tables and diagrams are also available outlining your generating set.

Never operate, maintain or repair your generating set without taking general safety precautions.

Aksa Jeneratör does not assume responsibility for possible errors.

Aksa Jeneratör reserves to make changes without prior notice.

1.	INTRODUCTION	1
2.	GENERAL SAFETY PRECAUTIONS	2
2.1.	General.....	2
2.2.	Handling.....	2
2.3.	Fire and Explosion.....	2
2.4.	Mechanical	3
2.5.	Chemical	3
2.6.	Noise.....	3
2.7.	Electrical	3
2.8.	First Aid for Electric Shock.....	4
3.	GENERAL DESCRIPTION	5
3.1.	Generating Set Description and Identification	5
3.2.	Generating Set Main Parts	5
3.3.	Diesel engine.....	6
3.4.	Engine Electrical System	6
3.5.	Cooling System.....	6
3.6.	Synchronous Alternator	6
3.7.	Coupling.....	6
3.8.	Fuel Tank and Base Frame.....	6
3.9.	Vibration Isolation	6
3.10.	Silencer and Exhaust System.....	6
3.11.	Control System.....	7
4.	ELECTRIC STARTING SYSTEM	7
4.1.	Battery Systems.....	7
4.2.	Maintenance Batteries	7
4.3.	Battery Maintenance.....	7
4.4.	Maintenance Free Batteries	7
4.5.	Control of the Battery.....	7
4.6.	Starting Aids	7
5.	HEALTHY and SAFETY	7
5.1.	Fire Protection	7
5.2.	Exhaust Gases.....	8
5.3.	Moving Parts.....	8
5.4.	Hazardous Voltages	8
5.5.	Water	8
5.6.	Coolant and Fuel.....	8
6.	GENERAL PRECAUTIONS AND CONTROLS WHICH MUST BE DONE AFTER STARTING UP THE GENERATING SET	9
7.	GENERATING SET CONTROL SYSTEM	9
7.1.	Control Panels	9
7.1.1.	Control System P 72 Panel Specifications	9
7.1.3.	Static Battery Trickle Charger	10
7.2.	Control System Options.....	10
7.2.1.	Heaters.....	10

8.	GENERAL PRECAUTIONS AND CONTROLS WHICH MUST BE DONE AFTER STARTING UP	
	THE GENERATING SET	10
9.	LUBRICATING OIL	10
9.1.	Oil Performance Properties	10
9.2.	Lubrication oil Recommendations for Lister-Petters engines	10
9.3.	Oil Viscosity.....	11
9.4.	Oil and Filter Changes.....	11
10.	GENERATING SET MAINTENANCE	12
11.	ENGINE TROUBLESHOOTING	15
12.	ALTERNATOR DESCRIPTION	16
12.1.	General.....	16
12.2.	Construction and Components.....	16
12.3.	Operation	16
12.4.	Automatic Voltage Regulator.....	16
12.5.	Insulation Test.....	16
13.	MECCALTE ALTERNATOR TROUBLESHOOTING	17
14.	STORAGE.....	17
14.1.	Storage	17
14.2.	Alternator Storage.....	18
14.3.	Battery Storage	18
14.4.	Preparing for operation after storage.....	18
15.	GENERAL PRECAUTIONS ABOUT WARRANTY	18
	CONTROL PANELS WIRING DIAGRAM	18

1. INTRODUCTION

Aksa Generating set is designed to be commissioned, when delivered, as soon as the necessary cooling water, antifreeze, fuel, lubrication oil and fully charged battery are provided. With its long years of experience, Aksa manufactures efficient, reliable and quality generating set.

This operating and maintenance manual is prepared to assist the operator in operation and maintenance of the generating set. Observing the advices and rules in this manual will ensure that the generating set operates in maximum performance and efficiency for a long time.

- Care should be taken to perform more frequent maintenance in dirty and dusty environments in order to keep the generating set in good working condition.

- Necessary adjustment and repairs should be made only by authorized and qualified persons.

- Each generating set has a model and a serial number indicated on a label on the base frame. This plate also indicates the manufacturing date, voltage, current, power in kVA and kW, frequency, power factor and weight of the generating set. These datas are necessary in spare part orders, for warranty validity and for service calls.

Gülbaier Cad. 1 Sok. Güneşli 34212 İstanbul / Türkiye		
Tel: +90 212 478 66 66 Fax: +90 212 651 60 40		
e-mail: aksa@aksa.com.tr http://www.aksa.com.tr		
MODEL	PRODUCT DATE	SERIAL NO
PRIME KVA		STANDBY KVA
PRIME A		STANDBY A
ALTERNATOR MODEL		ALTERNATOR SERIAL NO
DIMENSIONS L W H		FUEL TANK CAPACITY L
VOLTS		
Hz	cosφ	GROUP WEIGHT kg
PHASE	R.P.M	

"Assembled in Türkiye"

SZÜSTEST

CE

ISO 9001:2000

CERTIFICATION NO: 10-06

CERTIFICATION NO: 11-06

ETK-025-10

The generating set is designed to be safe when used in correct manner. However responsibility for safety rests with the personnel who install, use and maintain the set. If the following safety precautions are followed, the possibility of accidents will be minimized. Before performing any procedure or operating technique, it is up to the user to ensure that it is safe. The generating set should only be operated by personnel who are authorized and trained.

Only people that have the right skills should be allowed to operate, adjust, perform maintenance or repair on Aksa Jeneratör equipment. It is the responsibility of management to appoint operators with the appropriate training and skill for each category of job.

Skill level 1: Operator

An operator is trained in all aspects of operating the unit with the push- buttons, and trained to know the safety aspects.

Skill level 2: Mechanical technician

A mechanical technician is trained to operate the unit the same as the operator. In addition, the mechanical technician is also trained to perform maintenance and repair, as describe in the instruction manual, and is allowed to change settings of the control and safety system. A mechanical technician does not work on live electrical components.

Skill level 3: Electrical technician

An electrical technician and has the same qualifications as both the operator and the mechanical technician. In addition, the electrical technician may carry out electrical repairs within the various enclosures of the unit. This includes work on live electrical components.

Skill level 4: Specialist from the manufacturer

This is skilled specialist sent by the manufacturer or its agent to perform complex repairs or modifications to the equipment. In general it is recommended that not more than two people operate the unit, more operators could lead to un safe operating conditions. Take necessary steps to keep unauthorized person away from the unit and eliminate all possible source of danger at the unit.

The manufacturer does not accept any liability for any damage arising from the use of non-original parts and for modifications, additions or conversions made without the manufacturer's approval in writing.

2. GENERAL SAFETY PRECAUTIONS

2.1. General

- 1 The owner is responsible for maintaining the unit in a safe operating condition. Unit parts and accessories must be replaced if missing or unsuitable for safe operation.
- 2 Operate the unit only for the intended purpose and within its rated limits (pressure, temperature, speeds, etc.).
- 3 Gen-set and equipment shall be kept clean, i.e. as free as possible from oil, dust or other deposits.
- 4 To prevent an increase in working temperature, inspect and clean heat transfer surfaces (cooler fins, intercoolers, water jackets, etc.) regularly.
- 5 Take precautions against fire. Handle fuel, oil and anti-freeze with care because they are inflammable substances. Do not smoke or approach with naked flame when handling such substances. Keep a fire-extinguisher in the vicinity.

WARNING

! Read and understand all safety precautions and warnings before operating or performing maintenance on the generating set.

! Failure to follow the instructions, procedures, and safety precautions in this manual may increase the possibility of accidents and injuries.

! Do not attempt to operate the generating set with a known unsafe condition.

! If the generating set is unsafe, put danger notices and disconnect the battery negative (-) lead so that it cannot be started until the condition is corrected.

! Disconnect the battery negative (-) lead prior to attempting any repairs or cleaning inside the enclosure.

! Install and operate this generating set only in full compliance with relevant National, Local or Federal Codes, Standards or other requirements.

2.2. Handling

The following safety precautions should be noted:

WARNING

! Make electrical connections in compliance with relevant Electrical Codes, Standards or other requirements. This includes requirements for grounding and ground/earth faults.

! For stationary generating sets with remote fuel storage systems, make sure such systems are installed in compliance with relevant Codes, Standards or other requirements.

! Engine exhaust emissions are hazardous to personnel. The engine exhaust for all indoor generating sets must be piped outdoors via leak-free piping in compliance with relevant Codes, Standards and other requirements.



Ensure that hot exhaust silencers and piping are clear of combustible material and are guarded for personnel protection per safety requirements. Ensure that fumes from the exhaust outlet will not be a hazard.

! Never lift the generating set by attaching to the engine or alternator lifting lugs, instead use the lifting points on the base frame or canopy.

! Ensure that the lifting rigging and supporting structure is in good condition and has a capacity suitable for the load.

! Keep all personnel away from the generating set when it is suspended.

2.3. Fire and Explosion

Fuel and fumes associated with generating sets can be flammable and potentially explosive. Proper care in handling these materials can dramatically limit the risk of fire or explosion. However, safety dictates that fully charged BC and ABC fire extinguishers are kept on hand.

Personnel must know how to operate them.



WARNING

! Ensure that the generating set room is properly ventilated.

! Keep the room, the floor and the generating set clean. When spills of fuel, oil, battery electrolyte or coolant occur, they should be cleaned up immediately.

! Never store flammable liquids near the engine.



! Do not smoke or allow sparks, flames or other sources of ignition around fuel or batteries. Fuel vapors are explosive. Hydrogen gas generated by charging batteries is also explosive.

! Turn off or disconnect the power to the battery charger before making or breaking connections with the battery.

! To avoid arcing keep grounded conductive objects (such as tools) a way from exposed live electrical parts (such as terminals). Sparks and arcing might ignite fuel or vapors.

! Avoid refilling the fuel tank while the engine is running.

! Do not attempt to operate the generating set with any known leaks in the fuel system.

2.4. Mechanical

The generating set is designed with guards for protection from moving parts. Care must still be taken to protect personnel and equipment from other mechanical hazards when working around the generating set.

WARNING

! Do not attempt to operate the generating set with the safety guards removed. While the generating set is running do not attempt to reach under or around the guards to do maintenance or for any other reason.



! Keep hands, arms, long hair, loose clothing and jewelers away from pulleys, belts and other moving parts.

Attention: Some moving parts cannot be seen clearly when the set is running.

! If equipped keep access doors on enclosures closed and locked when not required to be open.



! Avoid contact with hot oil, hot coolant, hot exhaust gases, hot surfaces and sharp edges and corners.

! Wear protective clothing including gloves and hat when working around the generating set.

! Do not remove the radiator filler cap until the coolant has cooled.



Then loosen the cap slowly to relieve any excess pressure before removing the cap completely.

2.5. Chemical

Fuels, oils, coolants, lubricants and battery electrolyte used in this generating set are typical of the industry. However, they can be hazardous to personnel if not treated properly.

WARNING

! Do not swallow or allow skin contact with fuel, oil, coolant, lubricants or battery electrolyte. If swallowed, seek medical treatment immediately.



Do not induce vomiting if fuel is swallowed. For skin contact, wash with soap and water.

! Do not wear clothing that has been contaminated by fuel or lube oil.

! Wear an acid resistant apron and face shield or goggles

when servicing the battery. If electrolyte is spilled on skin or clothing, flush immediately with large quantities of water.

2.6. Noise

Generating sets that are not equipped with sound attenuating enclosures can produce noise levels in excess of 105 dB(A).

Prolonged exposure to noise levels above 85 dB(A) is hazardous to hearing.



WARNING

Ear protection must be worn when operating or working around an operating generating set.

2.7. Electrical

Safe and efficient operation of electrical equipment can be achieved only if the equipments is correctly installed, operated and maintained.



WARNING

! The generating set must be connected to the load only by trained and qualified electricians who are authorized to do so, and in compliance with relevant Electrical Codes, Standards and other regulations.

! Ensure that the generating set, including a mobile set is effectively grounded/earthed in accordance with all relevant regulations priors operation.

! The generating set should be shutdown with the battery negative (-) terminal disconnected prior to attempting to connect or disconnect load connections.

! Do not attempt to connect or disconnect load connections while standing in water or on wet or soggy ground.

! Do not touch electrically energized parts of the generating set and/or interconnecting cables or conductors with any part of the body or with any non insulated conductive object.

! Replace the generating set terminal box cover as soon as connection or disconnection of the load cables is complete. Do not operate the generating set without the cover securely in place.

! Connect the generating set only to loads and/ or electrical systems that are compatible with its electrical characteristics and that are within its rated capacity.

! Keep all electrical equipment clean and dry. Replace any wiring where the insulation is cracked, cut, abraded or otherwise

degraded. Replace terminals that are worn, discolored or corroded. Keep terminals clean and tight.

! Insulate all connections and disconnected wires.

! Use only Class BC or Class ABC extinguishers on electrical fires.

2.8. First Aid for Electric Shock

WARNING

! Do not touch the victim's skin with bare hands until the source of electricity has been turned off.

! Switch off power if possible other wise pull the plug or the cable away from the victim.

! If this is not possible, stand on dry insulating material and pull the victim clear of the conductor; preferably using insulated material such as dry wood.

! If victim is breathing, turn the victim clear of the conductor, preferably using insulated material such as dry wood.

! If victim is breathing, turn the victim into the recovery position described below. If victim is unconscious, perform resuscitation as required;

Open the airway

Tilt the victim's head back and lift the chin upwards.

Remove objects from the mouth or throat (including false teeth, tobacco or chewing gum).

Breathing

Check that the victim is breathing by looking, listening and feeling for the breath.

Circulation

Check for pulse in the victim's neck.

If no breathing but pulse is present

- Pinch the victim's nose firmly.
- Take a deep breath and seal your lips around the victim's lips.
- Blow slowly into the mouth watching for the chest to rise. Let the chest fall completely.
- Give breaths at a rate of 10 per minute.
- If the victim must be left to get help, give 10 breaths first and then return quickly and continue.
- Check for pulse after every 10 breaths.

- When breathing restarts, place the victim into the recovery position described later in this section.

If no breathing and no pulse

- Call or telephone for medical help.
- Give two breaths and start chest compression as follows:
 - Place heel of hand 2 fingers breadth above ribcage/breastbone junction.
 - Place other hand on top and interlock fingers.
 - Keeping arms straight, press down 4-5 cm at a rate of 15 times per minute.
 - Repeat cycle (2 breaths and 15 compressions) until medical helps takes over.
 - If condition improves, confirm pulse and continue with breaths. Check for pulse after every 10 breaths.
 - When breathing restarts, place the victim into the recovery position described below.



Recovery position

- Turn the victim onto the side.
- Keep the head tilted with the jaw forward to maintain the open airway.
- Make sure the victim cannot roll forwards or backwards.
- Check for breathing and pulse regularly. If either stops, proceed as above.



WARNING

! Do not give liquids until victim is conscious



3. GENERAL DESCRIPTION

3.1. Generating Set Description and Identification

Diesel –electric generating sets are independent units for the production of electric power; basically, they comprise a constant voltage synchronous generator driven by an internal –combustion, diesel –cycle engine.

The sets are used for two main purposes:

a- Continuous duty sets,

Used to produce electric power for countless requirements (motive power, lighting, heating, etc) in areas where other sources of power are unavailable.

b- Emergency duty sets,

Used during public network failures, when such failures are liable to cause serious trouble to persons or material or financial damage (i.e. in hospitals, industrial plants with non-stop operating cycles, etc) or to meet peak energy demands. According to their application, the sets are further divided into:

- set for use on land
- set for use at sea

The sets for use on land can be either:

- stationary sets (fixed installation), or
- mobile sets (mobile installation)

These two types of sets are available in a vast range of versions, for every operating requirement, the main ones being:

01. hand control generating sets
02. stand-by generating sets

The standard stationary generating set comprises:

- diesel engine
- synchronous generator
- coupling
- metal sub-base with vibration isolators
- starter batteries
- fuel tank within the bed-plate
- instrument panel
- exhaust gas silencer.

Aksa Generating Set has been designed as a complete package to provide superior performance and reliability. Figure. 3.1. identifies the major components. This figure is of a typical generating set. However, every set will be slightly different due to the size and configuration of the major components. This

section briefly describes the parts of the generating set. Further information is provided in later sections of this manual. Each generating set is provided with a Rating Label (Item 1) generally fixed to the base frame. This label contains the information needed to identify the generating set and its operating characteristics. This information includes the model number, serial number, output characteristics such as voltage and frequency, output rating in kVA and kW, product date and weight.

The model and serial numbers uniquely identify the generating set and are needed when ordering spare parts or obtaining service or warranty work for the set.

Aksa generating sets are an Alternating Current generator, built for continuous running at sites where no electricity is available (some models are excepted) or as stand-by in case of interruption of the mains.

The generator operates at 230/220 V. in line-to-neutral mode and 400/440 V in line-to-line mode.

3.2. Generating Set Main Parts

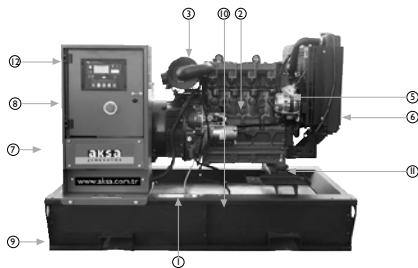


Figure 3.1. Typical generating set configuration

No	Description
1	Aksa generating set rating label
2	Diesel engine
3	Air filter
4	Battery
5	Battery charging alternator
6	Radiator
7	Alternator
8	Terminal box
9	Base frame
10	Fuel tank (inside the base frame)
11	Vibration isolators
12	Control Panel

3.3. Diesel Engine

The diesel engine powering the generating set (Item 2) has been chosen for its reliability and the fact that it has been specifically designed for powering generating sets. The engine is of the heavy duty industrial type with 4 stroke compression ignition and is fitted with all accessories to provide a reliable power supply. These accessories include, among others, a cartridge type dry air filter (item 3) and a mechanical or an electronic engine speed governor.

The engine cylinder block is cast in one piece cast iron, vertical cylinders inline overhead valves.

The cylinder head is made of special cast iron. The thermally loaded flame plate is efficiently water cooled.

The crankshaft is forged in one piece in a high tensile steel. Lubrication: forced lubrication via gear pump, special paper cartridge –type filters, lubricant cooling via heat exchanger on most versions.

3.4. Engine Electrical System

The engine electrical system is 12 volt volts DC, negative ground/earth. This system includes an electric engine starter, a battery (item 4) and a battery charging alternator (item 5). For 12 volts electrical system one battery is given. Other types of batteries may be fitted if they were specified.

3.5. Cooling System

The engine cooling system is water cooled. The water cooled system is comprised of a radiator (item 6) a pusher fan and thermostat. The alternator has its own internal fan to cool the alternator components.

3.6. Synchronous Alternator

Horizontal axle alternator (synchronous three phase), on rolling bearings, self-ventilated within the room with low-loss silicon-sheet stator bundle, electrolytic copper winding with class H insulation.

The output electrical power is normally produced by a screen protected and drip-proof self-exciting, self regulating, brushless alternator. (Item 7) Fine tuned to the output of this generating set. Mounted on top of the alternator is a sheet steel terminal box (item 8)

3.7. Coupling

Engine and alternator are firmly joined by a coupling cone that guarantees the proper assembly coaxiality

Mono-support machines are also used a special flexible disk is used in place of a flexible coupling.

3.8. Fuel tank and Base frame

The engine and alternator are coupled together and mounted on a heavy duty steel base-frame (Item 9). This base frame includes a fuel tank (Item 10) with capacity of approximately 8 hours operation under variable loads. The tank is complete with filling cap and fuel level gauge and is connected by flexible joints to the intake piping and to the overflow piping containing fuel from the injector drain. High power gen-set's fuel tank is separate from set.

3.9. Vibration Isolation

The generating set is fitted with vibration isolators (Item 11) which are designed to reduce engine vibration being transmitted to the foundation on which the generating set is mounted. These isolators are fitted between the engine /alternator feet and the base frame.

3.10. Silencer and Exhaust system

Exhaust gases from the turbocharger are discharged toward atmosphere through a silencer. These should be vented as high as possible, and must be prevented from re-entering the engine via the charge air intake, or polluting the radiator fins. It is important to note that the turbocharger nozzles must be always free of loads. Stainless steel exhaust compensator(s) is delivered with generator set.

Exhaust lines of different engines shall not be mixed in a common stack, but routed separately in individual ducts, enclosed in a chimney.

Suitable material is carbon steel sheet, and recommended calculation temperature is 475°C. Rain and condensate permanent draining shall be provided to prevent water entering the silencer and the engine.

An exhaust silencer is provided loose for installation with the generating set. The silencer and exhaust system reduce the noise emission from the engine and can direct exhaust system reduce the noise emission from engine and can direct exhaust gases to safe outlets.

The exhaust silencer is made of a carbon steel receiver containing sound attenuator and wave de-phasing system made of perforated steel sheet and heavy rock wool. It is asbestos-free. The exhaust silencer is delivered in two configurations with an industrial attenuation and residential attenuation.

3.1.1. Control System

One of several types of control systems and panels (item 12) may be fitted to control the operation and output of the set and to protect the set from possible malfunctions. Section 11 of this manual provides detailed information on these systems and will aid in identification of the control system fitted on the generating set.

4. ELECTRIC STARTING SYSTEMS

Electric starting systems are generally used on all gen-sets. The power source for electric starting systems is a 12 VDC battery system. Control of starting is via a start solenoid which is controlled by the gen-set control system.

4.1. Battery Systems

Battery type is lead acid. Lead acid batteries are generally used, being the least expensive.

4.2. Maintenance Batteries

Warning

- Do not smoke or allow sparks, flames or other sources of ignition around batteries. Hydrogen gas generated by charging batteries is explosive.
- Wear an acid resistant apron and face shield or goggles when servicing the battery. If electrolyte is spilled on skin or clothing, flush immediately with large quantities of water.
- Take out the metallic things in your wrist and protect your wrist and hand.
- Disconnect the battery negative (earth) lead first and reconnect last.
- Always ensure that battery charging is carried out in a well ventilated area.

The starting batteries should be located as close as possible to the generating set while still being accessible for servicing. This will prevent electrical losses

4.3. Battery Maintenance

- Keep the top of the battery and its terminals clean.
- Cover the battery terminals and its connections with Vaseline.
- Tighten the terminals but not tighten it hardly.
- Control the electrolyte level periodically. It must be 10 mm above the plates.
- Control the abrasion in the charge alternator belt and check periodically the belt tension according to producer' recommendation.
- Ensure that your battery is not uncharged.

4.4. Maintenance Free Batteries

Ensure that all battery connections are correct and batteries are always charged. After that there is not any procedure for this batteries.

4.5. Control of the Battery

Conduct an inspection every time before testing the battery.

1. A white powdered element causes abrasion to the pole-heads, its connections. Remove the connections and wash them with hot water to purify the oxidation. Reconnect it and coat with vaseline.

2. Check if any un-tightened connections exist.

4.6. Starting Aids

It is customary to maintain coolant temperatures above 40°C min. to promote quick starting on an emergency generating set and to take the load. Thermostatically controlled immersion heaters, deriving their supply from the primary source of power are fitted in the engine cooling system to provide this heating. Heater warms up the jacket water of the engine when the generating set is not working.

5. HEALTHY and SAFETY

Safety should be the primary concern of the facility design engineer and all personnel engaged on installation and commissioning. Safety involves two aspects:

- 1) Safe operation of the generator itself (and its accessories).
- 2) Reliable operation of the system.

Reliable operation of the system is related to safety because equipment affecting life and health, such as life support equipment in hospitals, emergency aggress lighting, building ventilators, elevators and fire pumps, may depend on the generator set.

5.1. Fire Protection

The design, selection and installation of fire protection systems require the following considerations:

- The fire protection system must comply with the requirements of National Standards.
- Typically, the generator room will be required to have a one hour fire resistance rating. Generator room construction will have to have a two hour fire resistance rating.
- Generator room shall not be used for storage purposes
- The authority may specify the quantity, type and sizes of approved portable fire extinguishers required for the generator room.

- A manual emergency stop station outside the generator room or enclosure or remote from the generator set in an outside enclosure would facilitate shutting down the generator set in the event of a fire or another type of emergency. General

- Do not fill fuel tanks when the engine is running, unless tanks are located outside the generator room.
- Do not permit any flame, cigarette, pilot light, spark, arcing equipment, or other ignition source near the generating set or fuel tank.
- Fuel lines must be adequately secured and free of leaks. Fuel connection at the engine should be made with an approved flexible line. Do not use copper piping on flexible lines as copper will become brittle if continuously vibrated or repeatedly bent.
- Be sure all fuel supplies have a positive shut-off.

5.2. Exhaust Gases

- Be sure the exhaust system will properly dispel discharged gases a way from enclosed or sheltered areas and areas where individuals are likely to congregate.
- Never connect the exhaust system of two or more engines.
- Never discharge engine exhaust into a brick, tile or cement block chimney, or a similar structure. Exhaust pulsations could cause severe structural damage.
- Do not use exhaust gases to heat a compartment.
- Be sure that the unit is well ventilated.
- Ensure that there is independent support for the exhaust system. No strain should be imposed on the engine exhaust manifolds. Which is especially important on a turbo-charged engine.

5.3. Moving Parts

- Tighten supports and keep guards in position over fans drive belts etc. Make sure that fasteners on the set are secure.
- Keep hands, clothing and clothing and jewellery away from moving parts.
- If adjustment must be made while the unit is running, use extreme caution around hot manifolds, moving parts, etc

5.4. Hazardous Voltages

Improper wiring can cause fire or electrocution, resulting in severe personal injury or death and property or equipment damage.

For personal protection, stand on a dry wooden platform or

rubber insulating mat, make sure clothing and shoes are dry, remove jewellery from hands and use tools with insulated handles.

- Do not leave cables trailing on the engine room floor.
- Do not use the same trunking for electric cables and fuel water lines.
- Do not run AC and DC cables in the same looms or trunking
- Always ensure that bonding and equipment earthing are correctly done. All metallic parts that could become energised under abnormal conditions must be properly earthed.
- Always disconnect the batteries and battery charger when serving or carrying out maintenance particularly on equipment arranged for automatic mains failure operation. Always disconnect a battery charger from its AC source before disconnecting the battery cable. Accidental starting of the generator set while working on it can cause severe personal injury or death.
- Do not tamper with interlocks.
- Do not connect the generator set directly to any building electrical system.
- Always follow all applicable state and local electrical codes. Have all electrical installations performed by a qualified licensed electrician.

High voltage sets work differently to low voltage ones. Special equipment and training is required to work around high voltage equipment. Operation and maintenance must be done only by persons trained and qualified to work on such devices. Improper use or procedures may well result in personal injury or death.

- Do not work on energised equipment. Unauthorised personnel must not be permitted near energised equipment. Due to the nature of high voltage electrical equipment includes voltage remains after the equipment is disconnected from the power source. Equipment should be de-energised and safety earthed.

5.5. Water

Water or moisture inside a generator increases the possibility of “flashing” and electrical shock, which can cause equipment damage and severe personal injury or death. Do not use a generator which is not dry inside and out.

5.6. Coolant and Fuel

The coolant heater must not be operated while the cooling

system is empty or when the engine is running or damage to the heater will occur. Coolant under pressure have a higher boiling point than water.

- Do not open a radiator, heat exchanger or header tank pressure cap while the engine is running. Allow the generator set to cool and bleed the system pressure first.
- Never use galvanised or copper fuel lines, fittings or fuel tanks. Condensation in the tanks and lines combines with the sulphur in the fuel to produce sulphuric acid. The molecular structure of the copper or galvanised lines or tanks reacts with the acid and contaminates the fuel.

6. GENERAL PRECAUTIONS AND CONTROLS WHICH MUST BE DONE BEFORE STARTING UP THE GENERATING SET.

- Make a general visual inspection on the engine and alternator. Check if there is any breakage, crack, indentation, leakage or looseness. Never operate the generating set before removing any fault, if any.
- Take out foreign materials such as keys, tools, cleaning wool, papers etc. on the engine and the alternator.
- Check the fuel level in day tank. Refill with fuel if it is low.
- Check the lubrication oil level on the dipstick. Refill with an appropriate oil if it is low. Oil level normally must be close to the maximum level line.
- Look at the water level by opening the radiator tap. If it is inadequate add more water.
- Engine cooling water must include antifreeze according to the coolest weather conditions in the area. A mixture of 50% antifreeze and 50% water provides a good protection in all area.
- Check the air filter gauge. Clean or replace air filter, if necessary.
- Keep the inlet opening open.
- Make sure that the generating set can easily take air from the environment.
- Check the battery connection cables. Take care to tighten the loosened battery terminals with spanner and, cover with special substance and keep clean in order to avoid oxidation.
- Open the battery caps and check the liquid level in the cells for maintenance type battery. Add distilled water, if necessary, so as to be 1 cm higher than the separation. Never fill the cells with tap water, acid water or acid.
- Check if the circuit breaker outlet switch is in OFF position.
- Make sure that the emergency stop button is not pressed

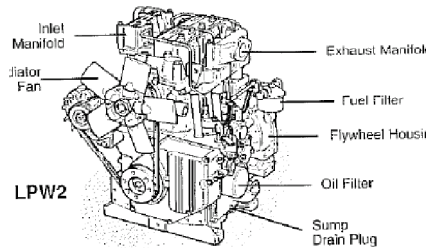


Figure 6.1. External Engine Components

7. GENERATING SET CONTROL SYSTEMS

To control and monitor the generating set, an electronic control system has been used.

P 72 model control system is fitted. Control panel provides a means of starting and stopping the generating set, monitoring its operation and output and automatically shutting down the set in the event of critical condition arising such as low oil pressure or high engine temperature.

7.1. Control Panel

Control, supervision and protection panels are mounted on the generator base frame.

7.1.1. Control System P 72 Panel Specifications

The control panel is equipped as follows:

Equipments:

- Control with DSE, model 720 module
- Static battery charger
- Emergency stop push button.

DSE 720 Module Features

- To monitoring AC mains supply
- Automatic controls generating set, start and stop
- Provide signal to change over switch
- Scrolling digital LCD display
- Front panel configuration of timers and alarm trip points
- Easy push button control

STOP/RESET - MANUAL – AUTO – TEST – START

Metering via LCD display

- Generator Volt (L – N)
- Generator Ampere (L1, L2, L3)
- Generator Frequency (Hz)
- Mains Volt (L – L / L – N)
- Engine cooling temperature

- Engine oil pressure
- Engine speed
- Engine hours run
- Engine battery volt

Alarms

- Over current
- Over speed
- Under / Over mains volt
- Under / Over mains frequency
- Low oil pressure
- High engine temperature
- Low battery volt
- Charge fail
- Start failure
- Emergency stop

LED indication

- Mains available
- Mains on load
- Generator available
- Generator on load

7.1.2. Static Battery Trickle Charger

This charger is designed to ensure that the starter batteries maintain their charge even if the generating set is not operated for long periods.

As an option, a battery charger ammeter may be fitted to the control panel in order for the operator to monitor the functioning of the battery charger.

7.2. Control System Options

A large variety of options may be fitted to customize the control system to a specific installation.

7.2.1. Heaters

Alternator anti-condensation heaters may be fitted to the alternator stator winding to keep them dry in humid conditions. Panel anti-condensation heaters may be fitted in the control panel to keep moisture levels down.

8. GENERAL PRECAUTIONS AND CONTROLS WHICH MUST BE DONE AFTER STARTING UP THE GENERATING SET

- Check for any abnormal noise or vibration on the generating set.
- Check if the exhaust system has any leakage.
- Monitor the generating set operation by means of the control module LCD display. Check the engine temperature and oil pressure. Oil pressure must reach the normal value 10 seconds after the generating set operation.
- Monitor the generating set outlet voltage and frequency

by means of the control module LCD display. Check the voltage, if the voltage between phases is 400 V. and between phase and neutral is 230 V. check that the frequency is 51 - 52 Hz on generating sets with mechanical governors and 50 Hz on generating sets with electronic governors.

- If an engine block water heater is not available, run the generating set at no-load for 8 minutes and when the engine warm than apply on load (for manual models) Apply load to the generating set as follows:
- Set the alternator outlet circuit breaker on the panel to ON position.
- Set the load circuit breakers (or fuses) on the distribution panel to ON position one by one. This way, the generating set cannot be suddenly put under full load. Otherwise, the engine stalling or alternator winding insulation of formation or burning can occur.
- Set the alternator outlet circuit breaker on the circuit to OFF position before stop the generating set.
- Continue to run the unloaded engine for purpose of cooling period for 5 minutes and then stop.
- Never operate the generating set before removing any fault, if any.

9. LUBRICATING OIL

Oil system of diesel engine is one of the most important elements of the engine. Correctly made engine overhaul (this subject includes oil change periods, filter change periods, paying attention about selecting the true type of oil) prolongs the life cost of the engine.

9.1. Oil Performance Properties

The American Petroleum Institute (API) the American Society for Testing and Materials (ASTM) and Society of Automotive Engineers (SAE) has developed and preserved a system in order to classify the lubrication oils for their performance categories

9.2. Lubrication Oil Recommendations for Lister Petter Engines

To help assist engine running-in, all engines are dispatched with an initial fill lubricating oil which must be changed after 100 hours.

1. The temperatures mentioned in the tables are the ambient temperatures at the time when the engine is started. However, if monograde oils are used and running ambient temperatures

are significantly higher than starting temperatures, a higher viscosity oil should be selected subject to satisfactory starting performance. Multigrade oils may be used to overcome the problem.

2. Where it is not practical to continually change oils to suit varying ambient temperatures a suitable multigrade oil is recommended to ensure adequate starting performance at the lowest temperature likely to be encountered.
3. All engines must be run on heavy duty lubricating oils that at least meet the requirements of the following:

API CC

DEF2101D

Straight mineral oils are not suitable, neither are oils of less detergency than specified.

Note: Higher specification oils meeting API CD, API CE and API CF-4 are more commonly available than API CC. The use of these oils in new engines is acceptable for topping up the 'first fill' and following the first 100 hours when running-in has been completed.


These oils are particularly suited to engines running at a high load factor, or in conjunction with high ambient temperatures. They must also be used where the sulphur content of the fuel exceeds 0,5%.

CAUTION !

API CD, API CE or API CF-4 oils can inhibit the running-in process in new or reconditioned engines and are not suitable for engines running on low duty cycles.

9.3. Oil Viscosity

The following chart shows the correct oil viscosities at various °C ambient temperature ranges for cold start to maximum running. Before selecting a viscosity grade refer to the Notes below the chart.

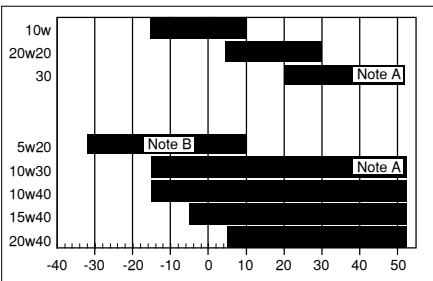

A – Intermittent running

B – Synthetic oils only

Fig.9.1. Recommended oil viscosity according to air temperature

Notes:

1. SAE 5W-20 oils are recommended on the basis that they are fully synthetic, and are technically suitable for use up to 25°C. Non synthetic oils at very low temperatures will suffer from wax crystallization. Monograde SAE 5W is not normally available as a synthetic oil and therefore is not quoted.
2. In order to maintain the cold starting characteristics of any recommended grade, it is essential that oil changes are made within the Lister-Petter recommendations. An oil change is recommended immediately if the engine fails to reach its normal cold start cranking speed due to excessive oil viscosity. Fuel dilution of the lubricating oil will adversely affect cold starting and oil consumption.
3. SAE 30 and 10W-30 oils may be used at up to 52°C but oil consumption may be affected. 10W-40, 15W-40 and 20W-40 multigrades are recommended for continuous full load operation at this temperature.
4. Monograde SAE 40 oils are not recommended.

9.4. Oil and Filter Changes

Change the lubricating oil and filter for the first time after 100 hours and then as specified below.

- Ambient temperature up to 35°C
250 periods in hours or every year, for 3000 rpm engines
- Ambient temperature above 35°C
125 periods in hour or every year s, for 3000 rpm engines
- Ambient temperature up to 35°C
500 periods in hours or every year, for 1500 rpm and 1800 rpm engines
- Ambient temperature above 35°C
250 periods in hours or every year, for 1500 rpm and 1800 rpm engines

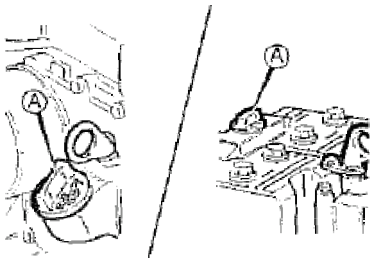


Fig.9.2. Oil Filler

Generating Set, 50 Hz, 400V			Fuel Consumption at Full Load	Fuel Tank Capacity	Coolant Capacity	Oil Capacity	Oil Specifications Not; Lubricating oil viscosity level will be chosen from Figure 7.1 according to the ambient temperature
Model	Standby Power kVA	Mitsubishi Engine Model					
ALP 8	8	LPW 2	1,9	50	5,5	3,2	API CC DEF 2101D
ALP 12	12	LPW 3	2,8	50	6,5	4	
ALP 15	15	LPW 2	3,9	50	5,5	3,2	
ALP 18	17,5	LPW 4	3,8	70	7,5	5,8	
ALP 22	22	LPW 3	5,9	50	6,5	4	
ALP 30	30	LPW 4	7,8	70	7,5	5,8	

Table 9.1. Fuel consumption and coolant, fuel and lubricating oil capacities and lubricating oil specifications (50 Hz Gen-sets)

10. GENERATING SET MAINTENANCE

A good maintenance program is the key to long generating set life. Maintenance and service should only be carried out by qualified technicians. The maintenance and service which are done must be recorded to the Maintenance Record Form. In general, the generating set should be kept clean. Do not permit liquids such as fuel or oil film to accumulate on any internal or external surfaces. Wipe down surfaces using an aqueous industrial cleaner.

10.1. Maintenance Schedule for Generator Sets

Using hour meter as a guide, perform all services at the hourly intervals indicated on following. At each maintenance interval, perform all previous maintenance operations in addition to the ones specified. Keep a record of hourly intervals and services performed.

Important: Recommended service intervals are for normal operating conditions. Service MORE OFTEN if engine is operated under adverse conditions. Neglecting maintenance can result in failures or permanent damage to the engine. Use correct fuels, Lubricants and coolant.

A. Daily or every 20 hours

Check

- Visually inspect engine, generator, transfer switch and control panel.
- For, Oil, Water and Fuel leaks.
- For, Coolant level, Oil level, Fuel level
- Battery charge level

- Operation of coolant heater
- Drain Fuel/Water separator
- Inspect the engine fan blades
- Inspect the drive belt

B. Weekly

Repeat Daily

Check

Fuel System

- Fuel level in main tank
- Day tank float switch
- Fuel transfer pump operation
- Fuel lines and connections

Cooling System

- Adequate fresh air to engine
- Hose and connections
- Battery charging alternator belts
- Inspect the engine fan blades
- Inspect the fan belt

Lubricating System

- Oil level
- Tighten connections

Exhaust System

- Exhaust leaks
- Tighten connections

Generator

- Vent screens
- Tighten covers
- Output voltage and frequency

Transfer Switch

- Operation under load
- No unusual sounds
- Terminals and connections normal colour
- Doors closed securely

C. First 100 service hours for new or overhauled engine

- Changing engine oil and oil filter
- Re-tighten bolts and nuts on engine

D. Every 250 service hours or every 1 year

- Changing engine oil and oil filter
- Checking and cleaning radiator fins for contamination or blockage
- Check the condition and tension of the radiator drive belt.
- Clean the fuel injector nozzles if the exhaust is dirty
- Renew the fuel filter element if the fuel is not perfectly clean.

E. Every 500 service hours

- Checking V-belt and adjusting belt tension
- Renew the fuel filter element.
- Renew the air cleaner element.
- Check the air induction system for leaks, damage and restrictions.

F. Every 1000 service hours

- Check all external nuts, bolts and unions for tightness.
- Ensure that all guards are firmly attached and not damaged
- Replace the fuel lift pump diaphragm; see Note:

G. Every 2000 service hours

- Decarbonise, if performance has deteriorated, renewing all joints and seals as necessary.
- Check the engine and speed controls for free movement.
- Clean and check, or replace, the fuel injector nozzles.
- Check the radiator fins and radiator fan blades for damage.
- Replace the fan drive belt
- Check the lubricating oil pressure.
- Renew the air cleaner element.

H. Every 6000 service hours

- The previous items and give the engine a major overhaul, if necessary

I. Every 1 years

- Drain and flush block water heater tube.
- Drain, flush and refill the cooling system adding new coolant concentrate to a 40% concentration.
- Drain and replace the lubricating oil and filter; irrespective of their condition, if the engine has run for less than 250 hours in the preceding twelve months.

J. Every 2 years

- Replace the coolant hoses irrespective of their condition.

K. As required

- Cleaning, checking, replacing air cleaner element
- Bleeding fuel system
- Draining water sedimentor

Note:

It is recommended that the fuel lift pump diaphragm is inspected at more frequent intervals if it is known the fuel is contaminated. It should also be inspected at regular intervals on engines in low duty cycle applications; for example, stand-by generating sets.

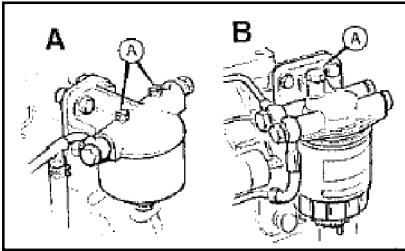


Fig.10.1. Priming the Fuel Filter. (A) The bleed screws

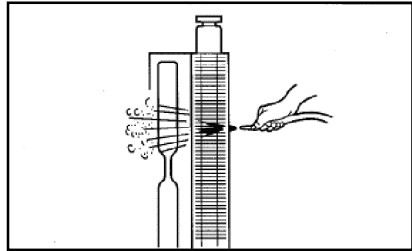


Fig.10.2. Cleaning radiator fins

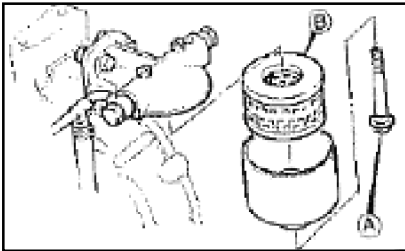


Fig.10.3. Changing fuel filter element. The centre bolt (A) of the filter assembly.

Filter element (B)

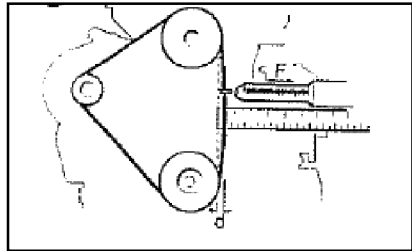


Fig.10.4. Tension adjusting V-belt

Drive Belt Tension

When a new belt is correctly fitted and tensioned a force (F) of 31.0 -33.5 N is required to deflect it a distance (d) of 3.5 mm. On subsequent checking and adjustment a force (F) of 22 - 24 N is required to deflect it a distance (d) of 3.5 mm.

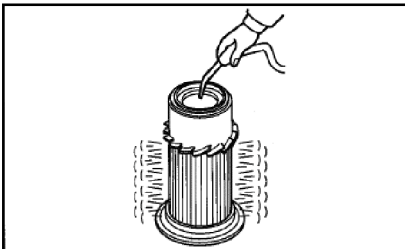


Fig.10.5. Cleaning air cleaner element

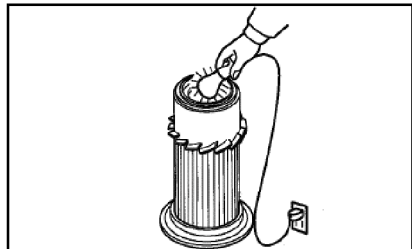


Fig.10.6. Checking air cleaner element

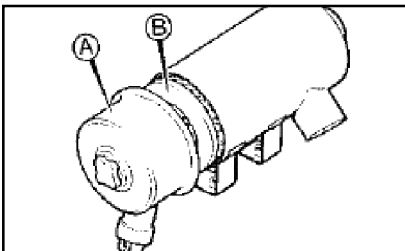


Fig.10.7. Air Cleaner; (A) dust cap, (B) paper element

11. ENGINE TROUBLESHOOTING

The starter motor turns the engine too slowly:

- Battery capacity to low
- Bad electrical connection
- Faulty in starter motor
- Wrong grade of lubricating oil

The engine does not start or difficult to start:

- Starter motor turns engine too slowly
- Fuel tank empty
- Fault in fuel control solenoid
- Restriction in a fuel pipe
- Fault in fuel lift pump
- Dirty fuel filter element
- Air in fuel system
- Fault in atomisers
- Cold start systems used incorrectly
- Fault in cold start system
- Restriction in fuel tank vent
- Wrong type or grade of fuel used
- Restriction in exhaust pipe

Not enough power:

- Restriction in a fuel pipe
- Fault in fuel lift pump
- Dirty fuel filter element
- Air in fuel system
- Restriction air filter/cleaner or induction system
- Restriction in exhaust pipe
- Fault in atomisers or atomisers of an incorrect type
- Restriction in fuel tank vent
- Wrong type or grade of fuel used
- Restricted movement of engine speed control
- Engine temperature is too high or low
- Loss of compression

Misfire

- Restriction in a fuel pipe
- Fault in fuel lift pump
- Dirty fuel filter element
- Air in fuel system
- Fault in atomisers or atomisers of an incorrect type
- Fault in cold start system
- Engine temperature is too high
- Incorrect valve tip clearances

The pressure of the lubrication oil is too low:

- Wrong grade of lubrication
- Not enough lubrication oil in sump
- Defective gauge
- Dirty lubrication oil filter element

High fuel consumption:

- Restriction air filter/cleaner or induction system
- Fault in atomisers or atomisers of an incorrect type
- Fault in cold start system
- Wrong type or grade of fuel used
- Restricted movement of engine speed control
- Restriction in exhaust pipe
- Engine temperature is too low
- Incorrect valve tip clearances

Black exhaust smoke:

- Restriction air filter/cleaner or induction system
- Fault in atomisers or atomisers of an incorrect type
- Fault in cold start system
- Wrong type or grade of fuel used
- Restriction in exhaust pipe
- Engine temperature is too low
- In correct valve tip clearances
- Engine over load

Blue or white exhaust smoke

- Wrong grade of lubrication
- Fault in cold start system
- Heavy blue smoke – caused by lubricating oil

Passing the piston due to:

Stuck, worn or broken rings. Worn cylinder bore Overfull oil sump

- Engine temperature is too low
- White smoke- generally as a result of water entering the cylinder.

The engine knocks:

- Fault in fuel lift pump
- Fault in atomisers or atomisers of an incorrect type
- Wrong type or grade of fuel used
- Fault in cold start system
- Engine temperature is too high
- In correct valve tip clearances

12. ALTERNATOR DESCRIPTION

12.1. General

The alternator fitted on the generating set is of the brushless self-excitation type which eliminates the maintenance associated with slip rings and brushes. The control system, consist of an automatic voltage regulator, protective circuits.

12.2. Construction and Components

The stator core is produced from insulated low loss electrical grade sheet steel laminations. These are built and welded under a fixed pressure to give an extremely rigid core to withstand vibration and load impulses. The complete wound stator is, after impregnation, pressed into the frame and pinned into position.

The rotor assembly, which comprises the alternator rotating field systems, the exciter rotating diode system and the cooling fan. The complete rotor assembly is dynamically balanced to ensure vibration-free running.

At the drive end of the rotor assembly a cast-aluminum centrifugal fan draws cooling air through screened covers at the non drive end and discharges it through similar side mounted covers at the drive end.

12.3. Operation

The electrical power produced by the generating set is derived from a closed loop system consisting principally of the exciter rotor: the main revolving field and the automatic voltage regulator (see Figure 12.1)

The process begins when the engine starts to rotate the internal components of the alternator. The residual magnetism in the main rotor produces a small alternating voltage (AC) in the main stator. The automatic voltage regulator rectifies this voltage (converts it to DC) and applies it to the exciter stator.

This DC current to the exciter stator creates a magnetic field which in turn, induces an AC voltage in the exciter rotor. This AC voltage is converted back to DC by the rotating diodes.

When this DC voltage appears at the main rotor, a stronger magnetic field than the original residual field is created which induces a higher voltage in the main stator. This higher voltage circulates through the system inducing an even higher DC voltage back at the main rotor. This cycle continuous to build up the voltage unit it approaches the proper output level of the generating set. At this point the automatic voltage regulator

begins to limit the voltage being passed to the exciter stator which, in turn, limits the overall power output of the alternator. This build-up process takes place in less than one second.

12.4. Automatic Voltage Regulator

The Automatic Voltage Regulator (AVR) maintains a no load to full load steady state voltage to tight tolerances. The AVR has a volt/hertz characteristic which proportionally reduces the regulated voltage at reduced speeds.

12.5. Insulation Test:

Before starting the generating set after installation, test the insulation resistance of the windings. The Automatic Voltage Regulator (AVR) should be disconnected and the rotating diodes either shorted out with temporary links or disconnected. Any control wiring must also be disconnected. A 500 V Megger or similar instrument should be used. Disconnect any earthing conductor connected between neutral and earth and megger an output terminal to earth. The insulation resistance should be in excess of 1 M Ω to earth. Should the insulation resistance be less than 1 M Ω the winding must be dried out.

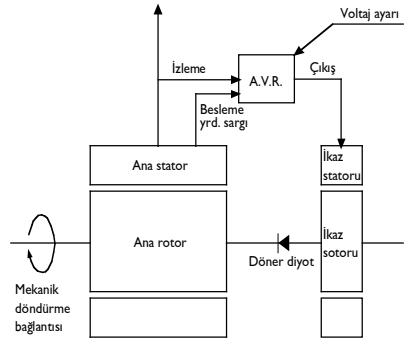


Figure.12.1. Alternator; operating principles block schematic diagram

13.Meccalte Alternator Troubleshooting

Symptom	Possible Cause	Corrective Action
Alternator does not excite	Blown fuse Insufficient residual voltage No residual voltage	Replace fuse Increase speed by 15 %. For an instant apply on the (+) and (-) terminals of the electronic regulator a 12V battery with 30 ohm resistor in series respecting the polarities.
After being excited alternator does no excite	Connections are interrupted	Check connection cables as per attached drawings.
Low voltage at no load	Voltage potentiometer out of setting Invention of protection. Winding failure	Reset voltage Check engine speed Check windings
High voltage at no load	Voltage potentiometer out of setting Failed regulator	Reset voltage potentiometer Substitute regulator
Lower than rated voltage at load	Voltage potentiometer out of setting Intervention by protection Failed regulator Rotating bridge failure	Reset voltage potentiometer Current to high, power factor lower than 0,8; speed lower than 4% of rated speed Substitute regulator Check diodes, disconnect cables.
Higher than rated voltage at load	Voltage potentiometer out of setting Failed regulator	Reset voltage potentiometer Substitute regulator
Unstable voltage	Speed variation in engine Regulator out of setting	Check regularity of rotation Regulate stability of regulator by acting on stability potentiometer.

14. STORAGE

Long term can have detrimental effects on both the engine and alternator. These effects can be minimized by properly preparing and storing the generating set.

14.1. Storage

- Store the generator in a dry, frost-free room which is well ventilated.
- Run the engine regularly, eg. Once a week, until it is warmed up. If this is impossible, extra precautions must be taken:
- Consult the engine's operator manual.

- Remove the battery. Store it in a dry, frost-free room. Keep the battery clean and its terminals lightly covered with petroleum jelly. Recharge the battery regularly.
- Clean the generator and protect all electrical components against moisture.
- Stick sheets of VCI paper with adhesive tape on the bodywork to close off all openings.
- Wrap the generator, except the bottom, with a plastic bag. If possible use space heaters to keep the windings dry.

14.2. Alternator Storage:

When an alternator is in storage, moisture tends to condense in the windings. To minimize condensation, store the generating set in a dry storage area. If possible use space heaters to keep the windings dry.

14.3. Battery Storage:

While the battery is stored, it should receive a refreshing charge every 8 weeks up to a fully charged condition

14.4. Preparing for Operation After Storage

Before operating the generator again, remove the wrapping, VCI paper and check the generator thoroughly (go through the checklist "6. Before starting").

- Consult the engine's operator manual.
- Check that the insulation resistance of the generator exceeds 5 M Ω .
- Reinstall and connect the battery, if necessary after being recharged.
- Submit the generator to a test run.

After removing the generating set from storage, perform an insulation check as discussed in Section 12.5.

15. GENERAL PRECAUTIONS ABOUT WARRANTY

DEAR AKSA GENERATING SET OPERATOR, PLEASE TAKE CARE TO THE FOLLOWING ORDER TO PREVENT THE GENERATING SET WARRANTY TO BECOME INVALID BEFORE THE TERMINATION OF THE WARRANTY PERIOD AND TO ENSURE TROUBLE-FREE OPERATION OF THE GENERATING SET WITH A LONG LIFE!

- MAINTENANCE AND REPAIR WORKS WILL NOT BE COVERED BY THE WARRANTY CERTIFICATE, INVOICE OR DELIVERY CERTIFICATE OF THE GENERATING SET IS SUBMITTED.
- THE WARRANTY OF THE GENERATING SET WILL BECOME INVALID IN CASE OF ANY INTERVENTION OF ANY PERSON OTHER THAN AUTHORIZED AKSA SERVICES OR BY PRIOR WRITTEN APPROVAL FROM AKSA POWER GENERATION ON THE GENERATING SET FOR ANY REASON.
- CONTROL AND MAINTENANCE WORKS INDICATED IN THE PERIODICAL MAINTENANCE SCHEDULE AND THE OPERATING MANUAL MUST BE


CARRIED OUT COMPLETELY AND TIMELY THE FAILURES DUE TO INCOMPLETE OR UNTIMELY MAINTENANCE ARE NOT COVERED BY THE WARRANTY.


- GENERATING SET SHOULD BE MOUNTED AS INDICATED IN THE OPERATING MANUAL OTHERWISE, THE PROBLEMS WHICH ARE LIKELY TO OCCUR WILL NOT BE COVERED BY THE WARRANTY CUSTOMER IS RESPONSIBLE FOR THE FAILURES WHICH ARE LIKELY TO OCCUR IN CASE THAT THE DIESEL OIL USED CONTAINS DIRT OR WATER.
- THE OIL TYPE INDICATED IN THE OPERATING MANUAL SHOULD BE USED IN THE ENGINE OTHERWISE, THE FAILURES WHICH ARE LIKELY TO OCCUR WILL NOT BE COVERED BY THE WARRANTY.
- BATTERIES WILL NOT BE COVERED BY THE WARRANTY IF THEY ARE SUBJECTED TO BREAKAGE, EXCESSIVE ACID FILL OR HARDENING BY LEAVING UNCHARGED.
- GENERATING SETS, NEVER START OR STOP THE DIESEL ENGINE WHEN THE GENERATING SET IS UNDER LOAD. ENGINE SHOULD BE STARTED AND STOPPED AFTER LOAD IS DISCONNECTED AND THE GENERATING SET IS AT IDLE CONDITION. OTHERWISE, THE VALVES CAN BE SEIZED, THE VOLTAGE REGULATOR, TRANSFORMER AND DIODES CAN BE BROKEN DOWN. THESE CONDITIONS ARE NOT COVERED WARRANTY.
- OUR COMPANY DOES NOT TAKE THE RESPONSIBILITY OF THE DAMAGES ON THE MAINS SUPPLY CONTACTOR OF THE AUTOMATIC GENERATING SETS DUE TO OVERCURRENT, LOW OR HIGH VOLTAGE.
- NEVER REMOVE THE BATTERY TERMINALS WHILE THE GENERATING SET IS IN USE. EVEN A MOMENT OF DISCONNECTION CAN CAUSE A DAMAGE ON THE ELECTRONIC CLOSING RELAY OF THE CHARGE ALTERNATOR AND ON THE ELECTRONIC ENGINE SPEED CONTROL CIRCUIT THESE CONDITIONS ARE NOT COVERED BY THE WARRANTY.
- FAILURES DUE TO OVERLOAD AND UNBALANCED LOAD IN EXCESS OF THE GENERATING SET POWER (SUCH AS ALTERNATOR AND CONTACTOR FAILURES) ARE NOT COVERED BY THE WARRANTY.


- WHEN THE MANUAL GENERATING SET IS STARTED UP, IT SHOULD BE WARMED BY OPERATING AT IDLE FOR 5 MINUTES . WHEN STOPPING THE DIESEL ENGINE, IT SHOULD BE UNLOADED AND THEN CONTINUED TO BE OPERATED FOR COOLING FOR 10 MINUTES BEFORE STOPPING. OTHERWISE PROBLEMS WHICH ARE LIKELY TO OCCUR WILL NOT BE COVERED BY THE WARRANTY
- WARRANTY PERIOD IS 1 YEAR BEGINNING FROM THE PURCHASE DATE.

Authorized Service Dealer may perform warranty repairs. Most warranty repairs are handled routinely, but sometimes requests for warranty service may not be appropriate. For example, warranty service would not apply if equipment damage occurred because of misuse, lack of routine maintenance, shipping, handling, warehousing or improper installation. Similarly, the warranty is void if the manufacturing date or the serial number on the equipment has been removed or the equipment has been altered or modified. During the warranty period, the Authorized Service Dealer, at its option, will repair or replace any part that, upon examination, is found to be defective under normal use and service. This warranty will not cover the following repairs and equipment:

- Normal Wear: Power Equipment and engines, like all mechanical devices, needs periodic parts and service to perform well. This warranty does not cover repair when normal use has exhausted the life of a part or the equipment.
- Installation and Maintenance: This warranty does not apply to equipment or parts that have been subjected to improper or unauthorized installation or alteration and modification, misuse, negligence, accident, overloading, over speeding, improper maintenance, repair or storage so as, in our judgment, to adversely affect its performance and reliability. This warranty also does not cover normal maintenance such as adjustments, fuel system cleaning and obstruction (due to chemical, dirt, carbon, lime, and so forth).
- Other Exclusions: This warranty excludes wear items such as oil gauges, o-rings, filters, fuses, or spark plugs, etc., or damage or malfunctions resulting from accidents, abuse, modifications, alterations, or improper servicing or freezing or chemical deterioration. Accessory parts are excluded from the product warranty. This warranty excludes failures due to acts of God and other force majeure events beyond the manufacturers control.

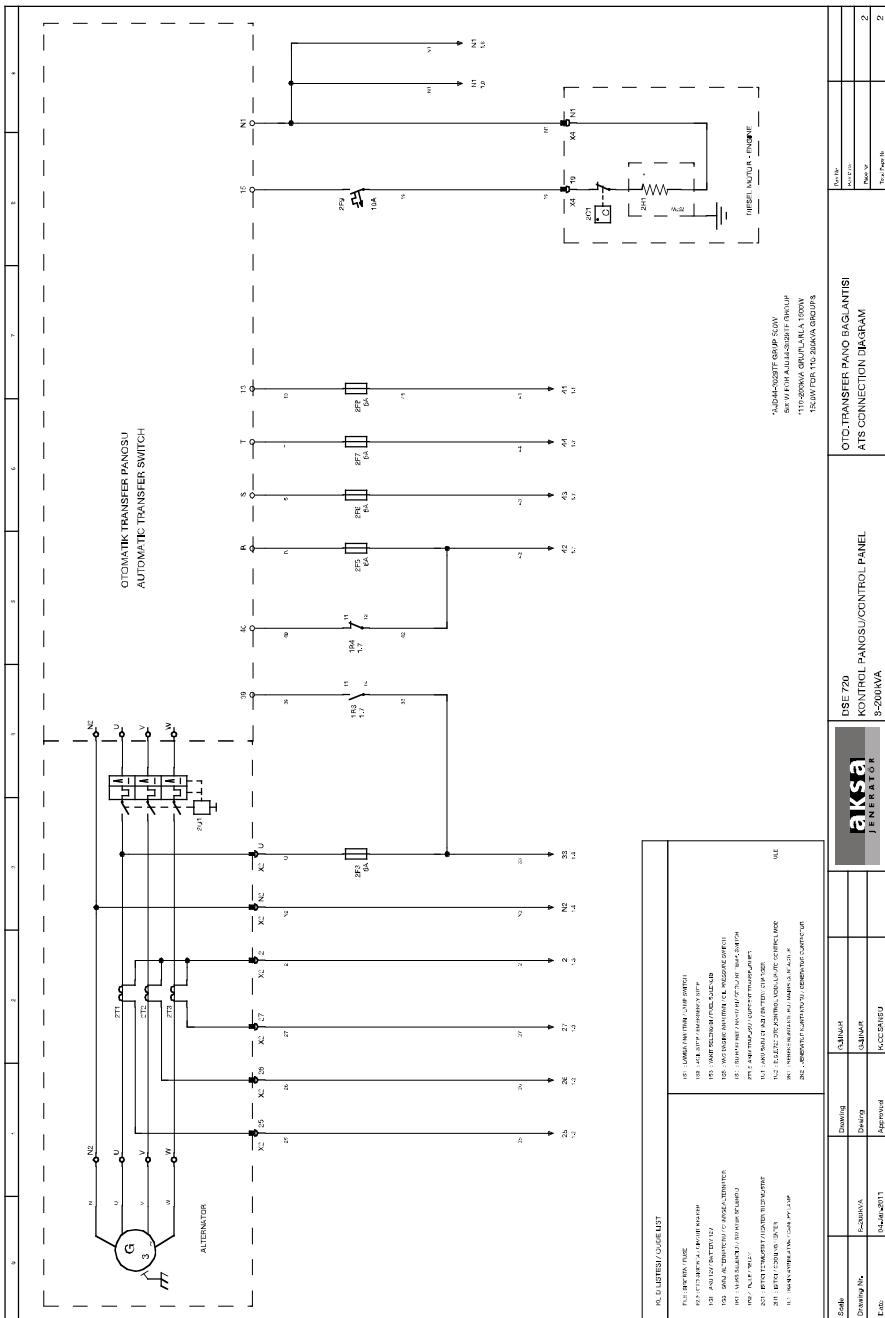

Scale	Drawing	QCM/447		DSE 720 CONTROL PANEL/CONTROL PANEL S-200KVA	OTD-TRANSFER PIANO BAGLIANTISI ATS CONNECTION DIAGRAM	Rev. No.
Drawing No.	Execution	Update				Rev. Date
04-04-2017	Approval	KCC/04/017				Page 12
						Page 12
						Tot. Foglietti

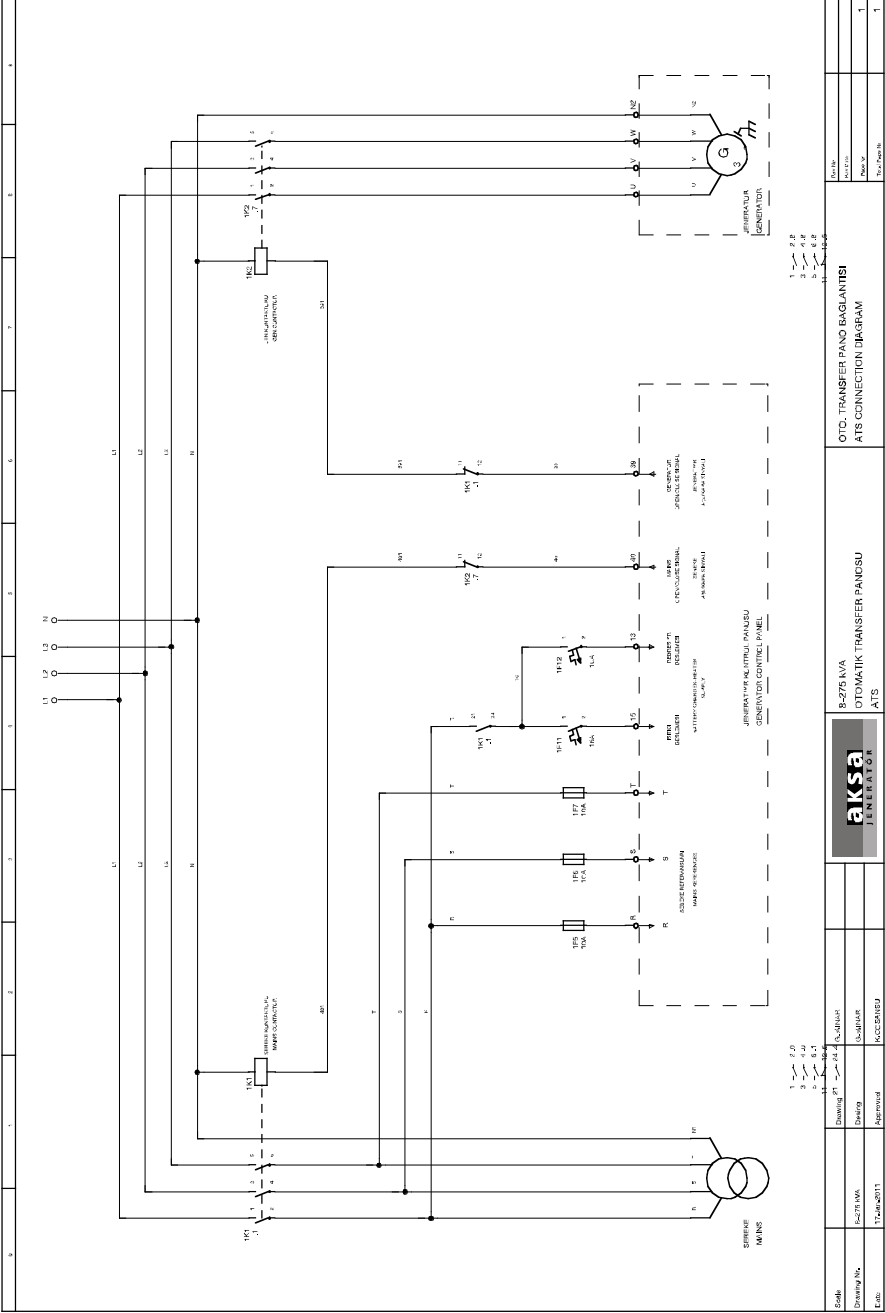

8-275 kVA
AUTOMATIC TRANSFER SWITCH
ATS

OTO TRANSFER PANO BAĞLANTISI
ATS CONNECTION DIAGRAM

Scale	1:1
Drawing No.	1
Revizyon	1
Revizyon No.	1

Scale	1:1
Drawing No.	1
Revizyon	1
Revizyon No.	1

Scale	1:1
Drawing No.	1
Revizyon	1
Revizyon No.	1

Scale	1:1
Drawing No.	1
Revizyon	1
Revizyon No.	1

Scale	1:1
Drawing No.	1
Revizyon	1
Revizyon No.	1

Scale	1:1
Drawing No.	1
Revizyon	1
Revizyon No.	1

AKSA JENERATÖR YETKİLİ SERVİS NOKTALARI

İSTANBUL AVRUPA YAKASI

AVCILAR
MUSTAFA KEMAL PAŞA MAH. YILDIRIM BEYAZIT CAD. DEMET SOK. NO:132 AVCILAR/İSTANBUL
T:0 212 428 66 66 PBX F:0 212 423 22 22

BAĞCILAR
ORTAK BÖLGE (GÖKSU) FATİH, ZEYİNBURNU, GAZİOSMANPAŞA, EYÜP
MERKEZ MAH. ATATÜRK CAD. NO:24 YENİBOSNA T:0212 630 79 80/0212 630 79 98

KAĞITHANE
ÇAĞLAYAN MAH. KAĞITHANE CAD. NO:93 KAĞITHANE
T:0212 222 13 38 PBX F:0212 210 08 81

KARAKÖY
NECATİBEY CAD NO.74 KARAKÖY / İSTANBUL T: 0212 251 92 48 - 293 07 32 - 33 F: 0212 251 92 64
DOLAPDERE SAN. SİT. 13.ADA NO:9 İKİTELLİ T: 0212 671 35 48 - 49 F: 0212 671 35 41

SEFAKÖY
YEŞİLOVA MAH. DİLEK SOK. NO:2 KÜÇÜKÇEKMECE
T:0212 425 65 80 (3 HAT) F:0212 425 65 84

İSTANBUL ANADOLU YAKASI

KADIKÖY
ESKİ ÜSKÜDAR YOLU CAD. MEZARLIK SK. NO:4 İÇERENKÖY
T:0216 469 58 58

PENDİK
AYDINEVLER ÂŞIK VEYSEL SOK. AK PLAZA NO:24 KÜÇÜKYALI/MALTEPE
T:0216 489 68 68 PBX F:0216 489 21 60

İSTANBUL DIŞI SERVİS NOKTALARI

ANKARA
ÇETİN EMEÇ BULVARI 2.CAD. 1309 SK. NO:7/A ÖVEÇLER
T:0312 472 71 71 F:0312 472 76 01

ADANA
TURHAN CEMAL BERİKER BUL. MERKEZ CAD.
ADANA İŞ MERKEZİ A BLOK NO:24/27 YEŞİLOBA SEYHAN
T:0322 428 11 61 PBX F: 0322 428 15 40

ANTALYA
YEŞİLOVA MAH. ASPENDOS BULVARI 196-I
T:0242 322 16 88 – 322 91 88 F:0242 322 97 55

BODRUM
ATATÜRK BUL. BEYLİKKIRLARI MEVKİİ
BALKANOĞLU-2 İŞ MERKEZİ G-BLOK NO:1 KONACIK
T:0252 358 70 30 F: 0252 358 70 25

BURSA
NİLÜFER TIC. MRK. ALAADDİNBEY MAH. 70 SK.
NO:30/A NİLÜFER
T:0224 443 53 15-16-17-18 F:0224 443 53 15

DENİZLİ
İZMİR ASFALTI NO:56 GÜMÜŞLER
T:0258 371 71 10/372 08 44 F:0258 372 09 46

GAZİANTEP
FATİH MAH. FEVZİ ÇAKMAK BULVARI NO:152 ŞEHİTKÂMİL
T:0342 321 39 59 F:0342 321 37 67

İZMİR
KAZIM DİRİK MAH. YENİYOL ANKARA CAD.
NO:75 BORNOVA
T:0232 461 82 82 F:0232 462 24 63

KAYSERİ
OSMAN KAVUNCU CAD. SOYLUM APT. NO:185/A
MELİKGAZI T:0352 336 17 42-43 F: 0352 336 17 40

DİYARBAKIR
URFA YOLU 1. KM. DR. SITKI GÖRAL CAD.
VELAT 3 APT.ALTİ NO:1
T:0412 238 04 44 PBX F:0412 238 10 11

MARMARİS
DATÇA YOLU CAD. NO:14/B
T:0252 413 58 93 F: 0252 413 85 93

TRABZON
YAVUZ SELİM BULVARI MANOLYA SİTESİ NO:281
T:0462 230 10 60-61 F: 0462 230 10 64

BRANCH OFFICES & WAREHOUSES



ALGERIA

Aksa Algeria
Chemin du Parc d'Attraction
Cooperative El Baraka No: 417 Tixerain
Bir Mourad Rais / Alger
T : + 213 21 40 26 72
F : + 213 21 40 27 94
e-mail: aksaalgeria@aksa.com.tr



KAZAKHSTAN

Aksa Kazakhstan Ltd.
MS4-6 Abdullinyh Str.
Corner of Tole Bi Str.
Almaty - Kazakhstan
T : + 7 727 250 67 31 / 250 67 41
F : + 7 727 250 67 91
e-mail: aksa@arna.kz



U.A.E.

Aksa Middle East FZE
Post Box 18167 Warehouse
No.RA68/LC07
Jebel Ali Free Zone - Dubai
T : + 971 4 880 91 40
F : + 971 4 880 91 41
e-mail: sales@aksa.ae



CHINA

Aksa Power Generation
(Changzhou) Co. Ltd.
Export Processing Zone
Xinzhu Road, Plant A1 - A2,
Changzhou / China
T : + 86 (0) 519 851 50 205
F : + 86 (0) 519 851 50 130
e-mail: aksa@aksapowergen.com



RUSSIA

OOO AKCA
107031, Petravka, 27
Moscow - Russia 7108862
T : + 7 495 710 88 62
F : + 7 495 641 52 00
e-mail : info@aksarussia.ru



UNITED KINGDOM

Aksa International (UK) Ltd
Unit 6, Pine Court Walker Road,
Bardon Hill Coalville Leicestershire,
LE67 1S2 U.Kingdom
T : + 44 (0) 1530 837 472
F : + 44 (0) 1530 519 577
e-mail: sales@aksa-uk.com



IRAQ

Aksa Power Generation (Iraq)
English Village House
No.353 Arbil / Iraq
T : + 964 (0) 771 199 18 56
e-mail: hakant@aksa.com.tr



SINGAPORE

Aksa Far East(Pte.) Ltd.
94 Tuas Avenue 11
639103 Singapore
T : + 65 6863 2832
F : + 65 6863 0392 - 6863 2956
e-mail: aksafe@aksafareast.com.sg



VIETNAM

Aksa Vietnam
43 Le Thi Hong Gam,
Dist. 1, HCM City - Vietnam
T : + 84 8 391 47 014
F : + 84 8 391 47 015
e-mail: apd@aksa.com.tr

aksa
JENERATÖR

AKSA JENERATÖR SANAYİİ A.Ş.



DECLARATION OF CONFORMITY AT – UYGUNLUK BEYANI

Üretici / Manufacturer : AKSA Jeneratör San.A.Ş.
Adres / Address : Gülbahar Cd. 1.Sokak, Güneşli 34212 İstanbul / Türkiye
Ürün Kodu / Product Code : /
Ürün Açıklaması : Otomatik Tip Kabinli Jeneratör
Production Description : Automatic Generator With Canopy

Deklarasyon / Declaration

AKSA Jeneratör San. A.Ş. olarak, yukarıda bilgileri verilmiş olan ürünün aşağıdaki Avrupa Birliği direktiflerine, standartlara ve bunların gerektirdiği şartlara uygun olduğunu beyan ederiz.

On behalf of AKSA Jeneratör San. A.Ş. We declare that above information in relation on the supply/manufacture of this in product is in conformity with the below stated standards, EC directives and provisions of them.

Avrupa Birliği Direktifleri / EC Directives

2006/42/AT : Makine Emniyeti Yönetmeliği
2006/42/EC : Machinery Safety Directive

2004/108/AT : Elektromanyetik Uyumluluk Yönetmeliği
2004/108/EC : Electromagnetic Compatibility Directive

2006/95/AT : Alçak Gerilim Yönetmeliği
2006/95/EC : Low Voltage Directive

Standartlar / Standards

- TS EN ISO 12100-1:2007 : Makinelerde Güvenlik - Temel Kavramlar, Tasarım İçin Genel Prensipler -Bölüm 1: Temel Terminoloji, Met.
EN ISO 12100-1:2003 : Safety of Machinery - Basic Concepts, General Principles For Design-Part 1: Basic Terminology, Methodology
- TS EN ISO 12100-2:2007 : Makinelerde Güvenlik - Temel Kavramlar, Tasarım İçin Genel Prensipler -Bölüm 2: Teknik Prensipler
EN ISO 12100-2:2003 : Safety of Machinery - Basic Concepts, General Principles For Design-Part 2: Technical Principles
- TS EN 614-1 : Makinelerde Güvenlik-Ergonomik Tasarım Prensipleri-Bölüm 1:Terminoloji ve Genel Prensipler
EN 614-1:2006 : Safety of Machinery-Ergonomic Design Principles-Part 1-Terminology And General Principles
- TS EN 60204-1 : Makinelerde Güvenlik - Makinelerin Elektrik Teçhizatı - Bölüm 1: Genel Kurallar
EN 60204-1:2006 : Safety of Machinery-Electrical Equipment Of Machines General Requirements
- TS EN 12601 : Gidip Gelmeli İçten Yanmalı Motor Tahrirli Jeneratör Grupları- Güvenlik
EN 12601:2001 : Reciprocating Internal Combustion Engine-Driven Generating Sets-Safety
- TS EN ISO 14121-1 : Makinelerde Güvenlik- Risk değerlendirilmesi - Bölüm 1: Prensipler
EN ISO 14121-1 : Safety of Machinery-Risk Assessment-Part 1: Principles
- TS EN 61000-4-2:2009 :Elektromanyetik Uyumluluk (EMU)-Bölüm 4-2: Deney ve Ölçme Teknikleri -Elektrostatik Boşalma Bağışıklık Deneyi
BS EN 61000-4-2:2009 :Electromagnetic Compatibility (EMC). Testing And Measurement Techniques. Electrostatic Discharge Immunity Test
- TS EN 61000-4-6:2009 : Elektromanyetik Uyumluluk (EMC)- Bölüm 4-6: Deney ve Ölçme Teknikleri- Radyo Frekans Alanlarının Neden Olduğu Temaslı Rahatsızlıklara Karşı Bağışıklık
BS EN 61000-4-6:2009 : Electromagnetic Compatibility (EMC). Testing And Measurement Techniques. Immunity to Conducted Disturbance Induced By Radio-Frequency Fields

Yayın / Issued by : AKSA Jeneratör San. A.Ş.
Yer-Tarih / Place-Date : İstanbul -
Firma Adına Yetkili : Mustafa KÜÇÜKBAŞ
Name of Authorized Representative
Unvan / Title : İşletme Müdürü
İmza / Signature :

AKSA JENERATÖR SANAYİİ A.Ş.**DECLARATION OF CONFORMITY
AT – UYGUNLUK BEYANI**

Üretici / Manufacturer : AKSA Jeneratör San.A.Ş.
Adres / Address : Gülbahar Cd. 1.Sokak, Güneşli 34212 İstanbul / Türkiye
Ürün Kodu / Product Code :/.....
Ürün Açıklaması / Production Description : Otomatik Tip Açık Jeneratör
Automatic Generator With Out Canopy

Declarations / Declaration

AKSA Jeneratör San. A.Ş. olarak, yukarıda bilgileri verilmiş olan ürünün aşağıdaki Avrupa Birliği direktiflerine, standartlara ve bunların gerektirdiği şartlara uygun olduğunu beyan ederiz.

On behalf of AKSA Jeneratör San. A.Ş. We declare that above information in relation on the supply/manufacture of this in product is in conformity with the below stated standards, EC directives and provisions of them.

Avrupa Birliği Direktifleri / EC Directives

2006/42/AT : Makine Emniyeti Yönetmeliği
2006/42/EC : Machinery Safety Directive
2004/108/AT : Elektromanyetik Uyumluluk Yönetmeliği
2004/108/EC : Electromagnetic Compatibility Directive
2006/95/AT : Alçak Gerilim Yönetmeliği
2006/95/EC : Low Voltage Directive

Standartlar / Standards

- **TS EN ISO 12100-1:2007** : Makinelerde Güvenlik - Temel Kavramlar, Tasarım İçin Genel Prensipler -Bölüm 1: Temel Terminoloji, Met.
EN ISO 12100-1:2007 : Safety of Machinery - Basic Concepts, General Principles For Design-Part 1: Basic Terminology, Methodology
- **TS EN ISO 12100-2:2007** : Makinelerde Güvenlik - Temel Kavramlar, Tasarım İçin Genel Prensipler -Bölüm 2: Teknik Prensipler
EN ISO 12100-2:2007 : Safety of Machinery - Basic Concepts, General Principles For Design-Part 2: Technical Principles
- **TS EN 614-1** : Makinelerde Güvenlik-Ergonomik Tasarım Prensipleri-Bölüm 1:Terminoloji ve Genel Prensipler
EN 614-1:2006 : Safety of Machinery-Ergonomic Design Principles-Part 1-Terminology And General Principles
- **TS EN 60204-1** : Makinelerde Güvenlik - Makinelerin Elektrik Tesisatı - Bölüm 1: Genel Kurallar
EN 60204-1:2006 : Safety of Machinery-Electrical Equipment Of Machines General Requirements
- **TS EN 12601** : Gidip Gelmeli İçten Yanmalı Motor Tahrikli Jeneratör Grupları- Güvenlik
EN 12601:2001 : Reciprocating Internal Combustion Engine-Driven Generating Sets-Safety
- **TS EN ISO 14121-1** : Makinelerde Güvenlik- Risk değerlendirme - Bölüm 1: Prensipler
EN ISO 14121-1 : Safety of Machinery-Risk Assessment-Part 1: Principles
- **TS EN 61000-4-2:2009** : Elektromanyetik Uyumluluk (EMU)-Bölüm 4-2: Deney ve Ölçme Teknikleri -Elektrostatik Boşalma Bağışıklık Deneyi
BS EN 61000-4-2:2009 : Electromagnetic Cmpatibilty (EMC). Testing And Measurement Techniques. Electrostatic Discharge Immunity Test
- **TS EN 61000-4-6:2009** : Elektromanyetik Uyumluluk (EMC)- Bölüm 4-6: Deney ve Ölçme Teknikleri- Radyo Frekans Alanlarının Neden Olduğu Temaslı Rahatsızlıklara Karşı Bağışıklık
BS EN 61000-4-6:2009 : Electromagnetic Compatibility (EMC). Testing And Measurement Techniques. Immunity to Conducted Disturbance Induced By Radio-Frequency Fields

Yayın / Issued by : AKSA Jeneratör San. A.Ş.
Yer-Tarih / Place-Date : İstanbul -
Firma Adına Yetkili : Mustafa KÜÇÜKBAŞ
Name of Authorized Representative
Unvan / Title : İşletme Müdürü
İmza / Signature :

SANAYİ VE TİCARET BAKANLIĞI

GARANTİ BELGESİ

GARANTİ BELGESİ

Belge Numarası : **85233**

Belge İzin Tarihi : **18-06-2010**

Bu belgenin kullanılmasında; 4077 sayılı Tüketicinin Korunması Hakkında Kanun ve bu Kanuna dayanılarak yürürlüğe konulan Garanti Belgesi Uygulama Esasları'na Dair Yönetmelik uyarınca, T.C. Sanayi ve Ticaret Bakanlığı Tüketicinin ve Rekabetin Korunması Genel Müdürlüğü tarafından izin verilmiştir.

Sezer TURHAN
Bakan a.
GEN.MÜDÜR YARD.



aksa
J E N E R A T Ö R

İMALATÇI VEYA İTHALATÇI FİRMANIN

Ünvanı : AKSA JENERATÖR SANAYİ ANONİM ŞİRKETİ
Adresi : Gölbaşı Cad. 1. Sok. 34212
Göbeği / İSTANBUL
Telefon : (0212) 478 66 66 (pbx)
Telefax : (0212) 550 53 38

FİRMA YETKİLİSİNİN

İmzası ve Kaşesi :
MALİN


AKSA JENERATÖR
J E N E R A T Ö R
AKSA JENERATÖR SANAYİ A.Ş.

Cinsi : JENERATÖR
Markası : AKSA JENERATÖR
Modeli :
Seri No :
Teslim Tarih ve Yeri :
Azami Tamir Süresi : 30 İŞ GÜNÜ
Garanti Süresi : 2 (iki) YIL

SATICI FİRMANIN

Ünvanı :
Adresi :
Tel./Telefax :
Fatura Tarih ve No :

TARİH - İMZA - KAŞE

GARANTİ ŞARTLARI

- 1- Garanti süresi malın teslim tarihinden itibaren başlar ve 2 (iki) yıldır .
- 2- Malın bütün parçaları dahil olmak üzere tamamı firmamızın garantisini kapsamaktadır.
- 3- Malın garanti süresi içerisinde arızalanması durumunda, tamirle ilgili süre garanti süresine eklenir. Malın tamir süresi en fazla 30 (otuz) iş günüdür. Bu süre malın işlerin servisi istasyonuna, servis istasyonuna olmaması durumunda, malın satışı, bayii, acentası, temsilciliği, ithalatçısı veya imalatçısından birisine bildirilen tarihten itibaren başlar. Sanayi malının arızasının 15 iş günü içerisinde giderilmesi halinde, imalatçı veya ithalatçı; malın tamiri tamamlanmaya kadar, benzer özelliklere sahip başka bir sanayi malını tüketicinin kullanımına tahsis etmek zorundadır.
- 4- Malın garanti süresi içerisinde, gerek malzeme ve işçilik gerekse montaj hatalarından dolayı arızalanması halinde, işçilik masraflı değiştirilen parça bedeli ya da başka herhangi bir ad altında hiçbir ücret talep etmeksizin yapılacaktır.
- 5- Tüketicinin ortamın hakkını kullanmasını engellen malın,
 - Tüketicide teslim tarihinden itibaren garanti süresi içinde kalmak kaydıyla bir yıl içerisinde, aynı arzaya ikiden fazla tekrarlanması veya farklı arızaların dörtten fazla ortaya çıkması sonucu, malın yararlanamamasını süreklilik kazanması,
 - Tamiri için gereken azami sürenin aşılması,
 - Firmamız servis istasyonunun mevcut olmaması halinde sırası ile: satıcı, bayii, acentası, temsilciliği, ithalatçısı veya imalatçısı-üreticisinden birisini düzenleyeceği raporda arızanın tamirinin mümkün bulunmadığını belirtmesi, durumlarında tüketici malın ücretsiz değiştirilmesini, bedel haddesi veya ayıp oranında bedel indirimini talep edebilir.
- 6- Malın kullanma kılavuzunda yer alan hususlara aykırı kullanımdan, kaynaklanan arızalar garanti kapsamı dışındadır.
- 7- Garanti belgesi ile ilgili olarak çıkabilecek sorunlar için Sanayi ve Ticaret Bakanlığı, Tüketicinin ve Rekabetin Korunması Genel Müdürlüğü'ne başvurulabilir.

Not : Servisin Müdahalesi sırasında müşteri tarafından bu belge veya fatura ibraz edilmek zorundadır.

Genel Müdürlük / Head Office

TÜRKİYE / TURKEY
Gülbahar Caddesi 1.Sokak
34212 No:2 Güneşli - İstanbul
T: + 90 212 478 66 66
F: + 90 212 657 55 16
e-mail: aksa@aksa.com.tr

Aksa Servis / Aksa Service

TÜRKİYE / TURKEY
Murat Bey Beldesi,
Güney girişi Cad. No: 8
34540 Çatalca / İSTANBUL
T : + 90 212 887 11 11
F : + 90 212 887 10 20
e-mail: info@aksaservis.com.tr

Aksa Kiralama / Aksa Rental

TÜRKİYE / TURKEY
Murat Bey Beldesi,
Güney girişi Cad. No: 8
34540 Çatalca / İSTANBUL
T : + 90 212 887 12 12
F : + 90 212 887 15 25
e-mail: aksakiralama@aksakiralama.com.tr

B.A.E. / U.A.E.
Aksa Middle East
Post Box, No:18167 Jebel Ali Free Zone
Dubai - United Arab Emirates
T : + 971 4 880 9140
F : + 971 4 880 91 41
e-mail:sales@aksa.ae

Fabrikalar / Factories

TÜRKİYE / TURKEY
Taşocağı Yolu No:22
Mahmutbey Bağcılar
İSTANBUL
T : + 90 212 446 43 01
F : + 90 212 446 43 00
e-mail: aksa@aksa.com.tr

ÇİN / CHINA
Export Processing Zone
Xinzhu Road, Plant A1-A2,
Changzhou/China
T : + 86 519 851 502 05
F : + 86 519 851 501 30
e-mail: aksa@aksapowergen.com





Technical Library

<http://engine.od.ua>

